

NS series

**Retangular CAV and VAV air volume control terminals
with integral sound attenuator**

Description	Page
Type designation	1
Technical data	
- General	2
- Specification	3
- Installation instruction	3
Model overview / dimensions	4 - 5
Sound data NSODOOB	6 - 7
Sound data NSOFOOB	8 - 9
Sound data NSOK.OB / NSOR.OB	10 - 11
Sound data NSOM.OB / NSOT.OB	12 - 13

Retangular CAV and VAV air volume control terminals with integral sound attenuator

Type designation
(NS)

Composition type designation:

N - S - O - R - E - O - B

N Position 1: Product group

N = air volume control terminals

Ordering example:

N	S	O	R	E	O	B
---	---	---	---	---	---	---

2	0	0	R
---	---	---	---

1	0	0	0
---	---	---	---

See above

Model Handing controls & Heater

Reheat capacity

B Position 2: Function

O = not applicable

S = rectangular VAV or CAV terminal with integral sound attenuator

1 = non standard, specify separately

O Position 3: Controls (manufacturer)

O = without controls

For controls, contact our sales staff

Q Position 4: Outlet

O = not applicable

D = rectangular outlet and integral sound attenuation

E = circular outlet and integral sound attenuation

F = 4 circular outlets and integral sound attenuation

K = rectangular outlet, integral sound attenuation and provision for integral hot water reheat coil

L = circular outlet, integral sound attenuation and provision for integral hot water reheat coil

M = 4 circular outlets, integral sound attenuation and provision for integral hot water reheat coil

R = rectangular outlet, integral sound attenuation and provision for integral electric reheat coil

S = circular outlet, integral sound attenuation and provision for integral electric reheat coil

T = 4 circular outlets with integral sound attenuation and provision for integral electric reheat coil

1 = non standard, specify separately

Ordering codes "Specials"

N..1... - 3010 = 4 balancing dampers in 'Octopus' outlet

N..1... - 3006 = 'Octopus' with 6 outlets instead of 4

N..1... - 3016 = 'Octopus' with 6 outlets incl. balancing dampers

N..1... - FL = Flange connection 30 mm for rectangular outlet

E Position 5: Reheat coil

O = without reheat

A = 1-row hot water reheat coil

B = 2-row hot water reheat coil

D = 4-row hot water reheat coil

E = 1-stage 230VAC/1-phase electric reheat coil

F = 2-stage 230VAC/1-phase electric reheat coil

G = 3-stage 230VAC/1-phase electric reheat coil

H = 1-stage 400VAC/3-phase electric reheat coil

J = 2-stage 400VAC/3-phase electric reheat coil

1 = non standard, specify separately

O Position 6: Controls (type & function)

O = without controls

R = return/extract application

For controls, contact our sales staff

Ordering information:

Standard terminals:

- quantity of terminals
- complete 7 digit code
- terminal size or model
- air volume setting (V_{max} , V_{min} etc)
- control handing (standard right side)
- if applicable, electric reheat coil capacity

Non standard terminals:


- for non standard terminals a full description and/or drawing are requested

B Position 7: Sensor

O = not applicable

B = Flo-Cross®, 2 x 12 point averaging and signal amplifying air flow sensor (standard)

1 = non standard, specify separately

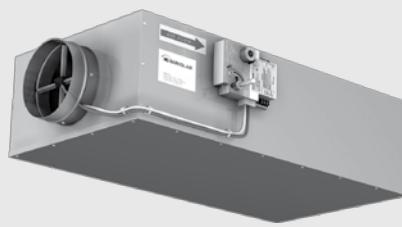

Application

Type NS rectangular pressure-independent VAV and CAV air volume control terminals are designed particularly for systems with low noise criteria and for the accurate measurement and control of air volumes courtesy of the patented airflow sensor type Flo-Cross®.

In CAV application, the terminals maintain the required constant airflow independent to the inlet static pressure.

In VAV application, the terminals control the air volume to the room, depending on the cooling load required thus saving energy consumption in both cooling and heating applications.

Alternatively VAV terminals are ideal to be used for CO₂ control. Dependent of the indoor air quality, always the correct amount of fresh air will be supplied to the room. Off course the primary air handling system need to be suitable for this.

The VAV or CAV terminals can be used either for supply or return air applications in new or refurbishment projects.

The terminals can optionally be supplied with a distribution plenum and a built-in hot water or electric reheat coil.

Features:

- Pressure independent control functions.
- Compact design; one-piece construction.
- Volume control range 100% down to 10%
- Low pressure loss over the terminal.
- Factory fitted in-built distribution plenum with built-in hot water or electric reheat coil.
- Low leakage damper, less than 2% of V_{nom} at 750 Pa.
- Very low noise production.
- Suitable for all control functions (VAV, CAV, shut-off, etc.) to maximise system energy savings.
- Flo-Cross® 2 x 12 points averaging and signal amplifying airflow sensor, better than 2,5% accuracy even with irregular duct approach.
- Maintenance free.

Technical information

Casing:

Air-tight construction made of galvanized sheet steel; casing leakage rate to Class II VDI 3803 / DIN 24 194. Duct-sleeve connections at the in- and outlet are suitable for DIN 24 145 or DIN 24 146 connections.

Insulation:

The terminal is supplied with 25 mm thermal and acoustical insulation (30 kg/m³) complying to: NFPA90A and 90B surface burning characteristics, BS476 part 6 and 7 fire propagation, UL 181 class 0 surface spread of flame and UL 94 HF1 flammability.

Special version insulation for hospital application on request.

Damper:

Damper blade: made of steel with neoprene gasket (low leakage).

Damper shaft: aluminium, ø12 mm with self lubricating Nylon bearings.

Flo-Cross®:

Extruded aluminium construction with nylon core + feet.

Distribution plenum:

Made of galvanized sheet steel with 13 mm internal isolation.

'Octopus' plenum with standard multiple outlet (4 x circular) outlet construction.

Optional single, double, triple or six circular outlets possible.

Outlet spigots are made of flame retardant polymer and optionally can be provided with volume control dampers made of galvanized sheet steel.

Reheat coil:

Choice of 1-, 2- or 4-row hot water reheat coil or electric reheat coil (230VAC/1-phase or 400VAC/3-phase).

More detailed technical information can be found in the separate NO documentation.

Controls:

Suitable for use with pneumatic, analogue electronic or DDC controllers. Controls can be factory fitted, wired and calibrated. Controls enclosure (galvanized sheet steel) can be provided optionally.


Delivery format

Delivery format:

- The VAV or CAV terminal will be supplied as a single mounting assembly. Optional ordered distribution plenum, reheat coil and/or controls are factory fitted, wired and calibrated. The on site delivered terminal is ready to be installed and commissioned.
- Controls location and hot water or electric connections are as a standard fitted on the right hand side of the terminal when looking in the direction of the airflow.
- On request, the terminal can be delivered with connections on the left hand side.
- When terminals are ordered with controls, these will be factory fitted, wired and calibrated upon request.
- When terminals are ordered with 'free-issue' controls by others, wiring diagrams and mounting instructions must be provided.

Retangular CAV and VAV air volume control terminals with integral sound attenuator

Technical data
Type NS . . .

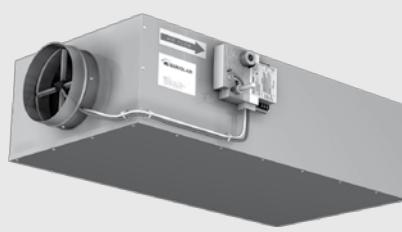

Specify as:

Example:

Supply and install, variable air volume terminals with integral sound attenuator and distribution plenum with 4 circular outlets, constructed from galvanized sheet steel. The casing leakage rate shall be classified according to class II, VDI 3803/DIN 24 194 and the duct-sleeve connections shall be suitable for DIN 24 145 or DIN 24 146 respectively. The VAV terminals shall have a low leakage damper blade with neoprene gasket and an aluminium damper shaft with self lubricating Nylon bearings. A centre averaging airflow sensor with at least 2 x 12 test points and amplified signal air flow sensor, type Flo-Cross® shall control the airflow with an accuracy not less than 2.5 %. The terminals shall be supplied with 1-row hot water reheat coil.

The controller shall be I/A Series, DDC controller:
LonMark® compatible, type MNL-V2RVx
or
BACnet® compatible typ MNB-V2.

Controls must be factory fitted, wired and calibrated according to the following requirements.

Maximum air volume 250 l/s
Minimum air volume 60 l/s
Minimum air volume 120 l/s (in case of reheat)
Terminal size 200 mm
Max. pressure loss 38 Pa
Max. discharge sound index < NC20
(@250Pa Δ p)
Max. radiated sound index < NC20
(@250Pa Δ p)

Ordering example: type – model – handing =
NSOMAOB – 200R

Manufacturer: HC Barcol-Air

Installation Instructions:


The HC Barcol-Air VAV terminals shall be installed using at least two support brackets (DIN-rail or L-profile), with anti-vibration rubber under the terminal. Each of these brackets shall be fixed with two threaded rods to the ceiling slab above.

This installation method:

- 1 Shall prevent the body of the VAV terminal from high mechanical tension, which could damage the construction and performance of the terminal.
- 2 Shall prevent torsion on the VAV terminals, which could cause malfunction of the damper blades.
- 3 Provides some flexibility to the final location of the VAV terminals.
- 4 Use at least 1x diagonal straight duct length before the VAV inlet.





- 5 Additional manual volume control dampers (VCD's) before the inlet are not required / recommended!!
- 6 All connections shall be thermally isolated.
- 7 Pressure sensing tubes of Flo-Cross® airflow sensor shall not be "kinked" or otherwise obstructed by the external duct insulation.

Optional 4 x Mupro fixing hooks can be used (see drawing).

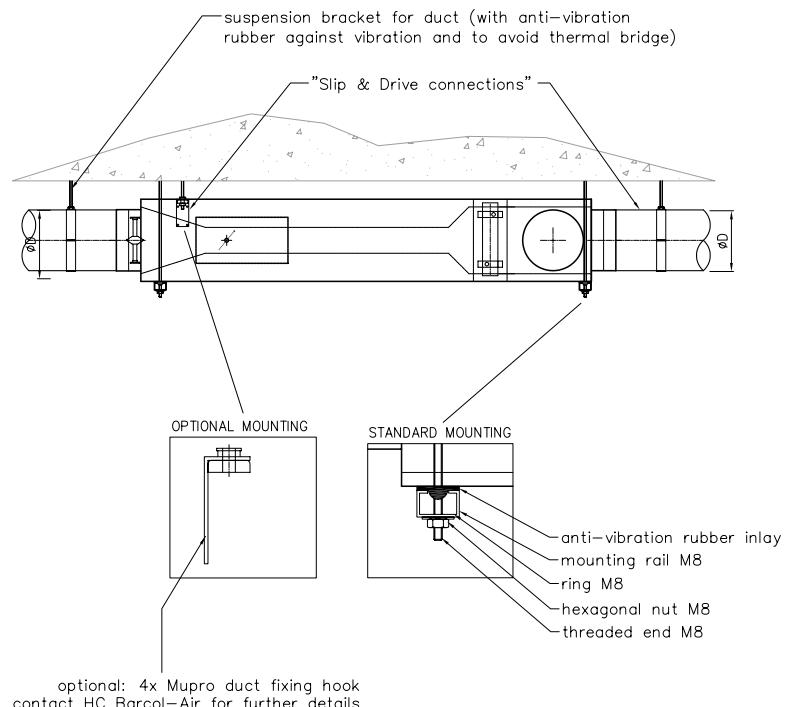

Retangular CAV and VAV air volume control terminals with integral sound attenuator

Model overview
(NS.....)

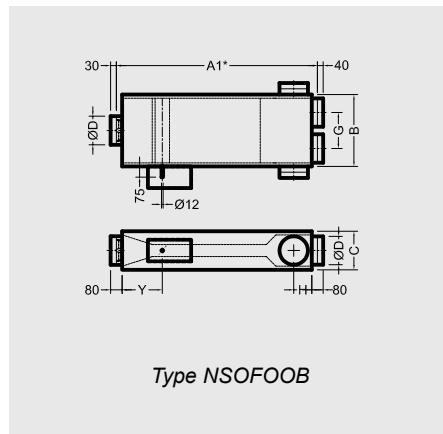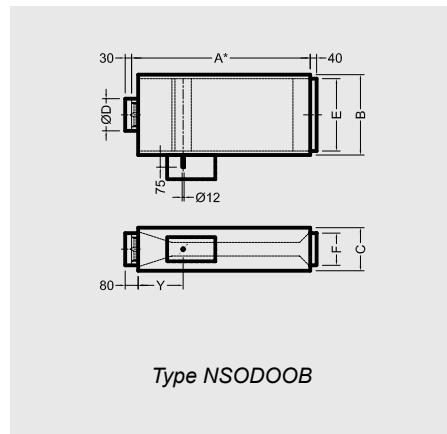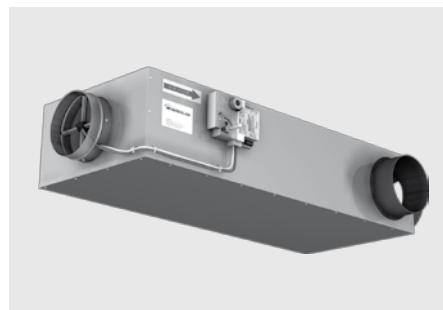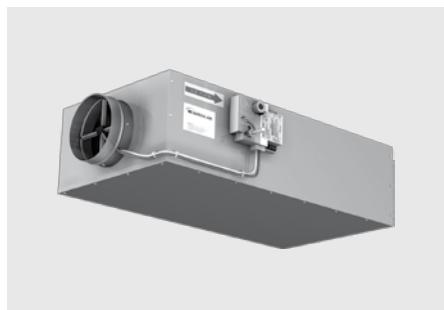

Dimensions NS

Model	100	125	160	200	250	315	355	400
A*	1110	1110	1110	1110	1110	1310	1310	1410
A1*	1360	1360	1360	1360	1460	1710	1710	1910
A2*	1260	1260	1260	1260	1260	1410	1410	1510
A3*	1510	1510	1510	1510	1610	1810	1810	2010
B	330	330	400	500	600	740	820	910
C	228	228	248	268	318	408	408	458
ØD	98	123	158	198	248	313	353	398
E	275	275	350	450	550	690	770	850
F	170	170	175	200	250	330	330	380
G	180	180	215	255	305	370	410	455
H	125	125	125	125	175	200	225	250
X**	330	330	330	330	430	480	530	580
X1**	352	352	352	352	452	502	552	602
Y	268	268	268	268	333	430	430	460

Other dimensions are available upon request.

All dimensions in mm.

* = Installed length.

** = Size varies with a 1-/2-row or 4-row hot water reheat coil.

Kv values

Model	100	125	160	200	250	315	355	400
Kv (l/s / Pa)	5,5	8,5	15,0	24,9	35,4	58,9	74,3	92,6

$$\text{Flow} = \text{Kv} \times \sqrt{\Delta P_{fc}}$$





ΔP_{fc} = Flo-Cross® signal

If $\Delta P_{fc} = 30 \text{ Pa}$ and VAV size = 160

$$\text{Flow} = 15,0 \times \sqrt{30} = 82 \text{ l/s}$$


Retangular CAV and VAV air volume control terminals with integral sound attenuator

Model overview
(NS.....)

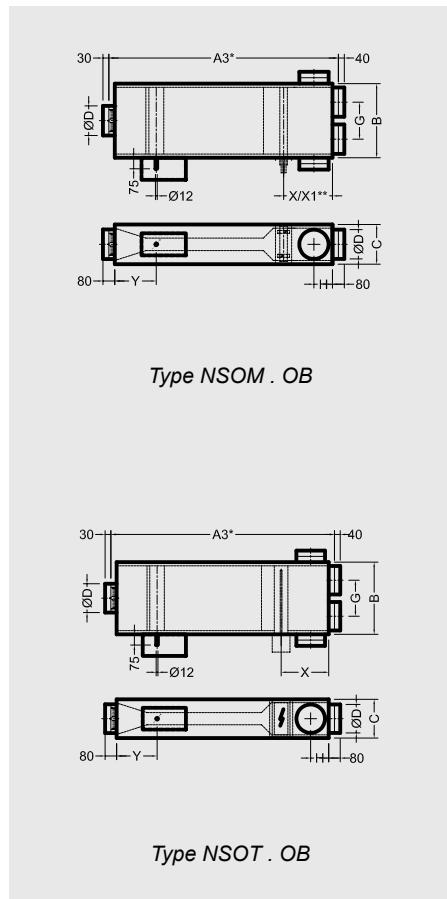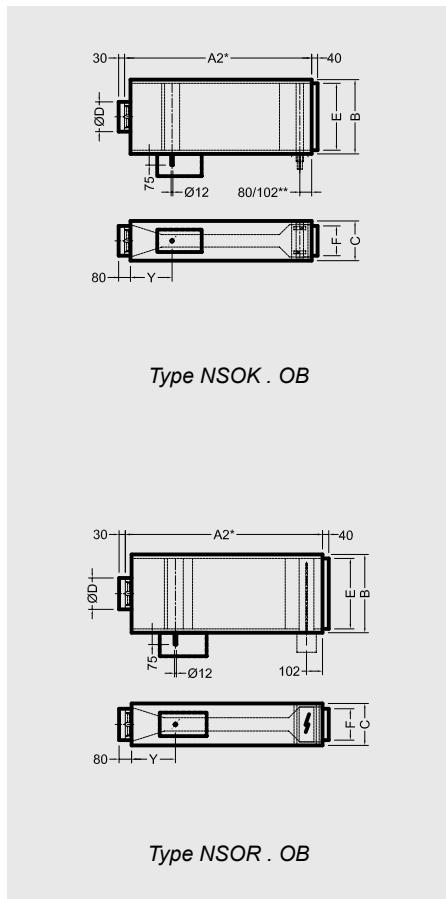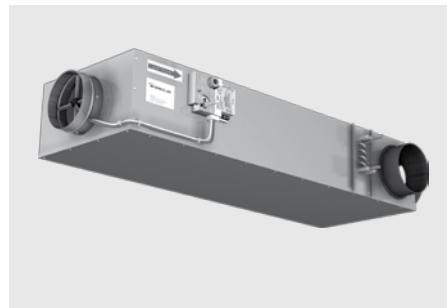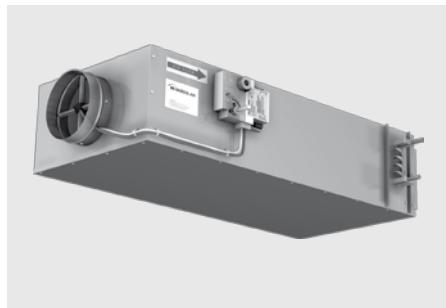

For dimensions see page 4.

Retangular CAV and VAV air volume control terminals Type NSODOOB with integral sound attenuator



Sound data $\Delta p = 125 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 125 \text{ Pa}$												
						discharge sound						radiated sound						
	air volume					Lw in dB/Oct. (re 1pW)				Lp values		Lw in dB/Oct. (re 1pW)				Lp values		
	velocity	m/s	l/s	CFM	m³/h	Pa	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	dB(A)	NC	NR
							dB						dB					
100	2	15	31	53	0	22	18	-	-	-	-	-	-	19	-	-	-	-
	4	29	62	106	1	29	28	-	-	-	-	-	-	22	23	-	-	18
	6	44	94	160	2	33	33	20	17	-	-	-	-	26	26	17	18	20
	8	59	125	213	4	35	37	24	20	-	-	-	-	28	28	19	20	21
	10	74	156	266	6	37	40	26	22	-	-	-	-	30	29	21	22	-
125	2	23	49	84	1	29	25	-	-	-	-	-	-	24	18	-	-	-
	4	47	99	168	2	36	35	22	-	-	-	-	-	29	23	21	-	-
	6	70	149	253	5	40	40	27	19	-	-	-	-	31	25	24	-	-
	8	94	198	337	8	42	44	31	22	-	-	-	-	33	27	26	18	17
	10	117	248	421	13	44	47	34	24	-	-	-	-	34	28	27	20	18
160	2	39	82	139	0	35	31	-	-	-	-	-	-	30	20	-	-	-
	4	78	164	279	2	39	38	24	-	-	-	-	-	37	30	19	-	-
	6	116	246	418	3	42	41	31	18	-	-	-	-	41	35	25	-	-
	8	155	328	558	6	43	44	36	23	-	-	-	-	44	40	30	21	-
	10	194	410	697	10	44	46	39	26	-	-	-	-	46	43	34	26	21
200	2	61	129	219	0	36	30	-	-	-	-	-	-	31	20	-	-	-
	4	122	258	439	2	41	37	24	-	18	20	-	-	38	30	-	-	-
	6	183	387	658	4	43	41	31	22	21	23	-	-	43	36	20	-	-
	8	244	516	878	8	44	43	35	27	23	24	-	-	46	40	25	20	20
	10	305	645	1097	12	45	45	39	31	25	26	-	-	48	44	28	25	21
250	2	96	203	345	1	31	21	-	-	-	-	-	-	26	18	-	-	-
	4	192	406	690	5	39	33	17	-	-	-	-	-	34	26	-	-	-
	6	288	609	1035	10	43	39	27	20	20	20	-	-	38	31	20	-	-
	8	383	812	1380	18	46	43	34	29	27	26	-	-	41	34	25	-	17
	10	479	1015	1725	28	48	47	39	35	33	30	20	-	44	37	28	20	-
315	2	153	324	550	1	-	-	-	-	-	-	-	-	22	19	-	-	-
	4	306	648	1101	4	32	31	18	-	18	-	-	-	34	29	17	-	-
	6	459	971	1651	8	42	40	30	25	26	25	-	-	42	34	25	-	-
	8	612	1295	2202	15	48	46	37	34	33	30	21	-	47	38	30	19	20
	10	764	1619	2752	23	54	51	43	41	38	33	26	-	51	42	34	24	-
355	2	195	412	701	1	-	18	-	-	-	-	-	-	23	19	-	-	-
	4	389	824	1401	5	33	34	24	-	-	-	-	-	36	29	-	-	-
	6	584	1236	2102	12	43	43	36	27	27	24	-	-	43	35	24	-	-
	8	779	1649	2803	22	50	49	44	37	34	29	23	-	48	39	29	19	19
	10	973	2061	3503	34	55	54	50	43	40	32	28	21	52	42	34	23	22
400	2	248	524	891	1	-	18	-	-	-	-	-	-	23	19	-	-	-
	4	495	1049	1783	4	33	34	26	18	19	-	-	-	36	28	-	-	-
	6	743	1573	2674	8	43	43	37	31	29	22	-	-	43	34	20	-	-
	8	990	2097	3565	15	50	49	45	40	37	27	23	-	49	38	26	-	22
	10	1238	2621	4456	23	55	54	51	47	42	30	28	21	53	42	30	20	18

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- Lw in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by “-”.
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

- dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by “-”.
- Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.
- For non standard applications and/or selections, please contact our technical staff.


Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	8	11	20	27	28	22	dB
125	7	10	19	26	27	21	dB
160	6	9	18	24	25	19	dB
200	5	10	16	22	23	20	dB
250	6	13	19	26	22	15	dB
315	6	12	19	25	21	17	dB
355	6	12	19	25	21	17	dB
400	5	11	15	19	19	14	dB

Rectangular CAV and VAV air volume control terminals Type NSODOOB with integral sound attenuator



Sound data $\Delta p = 250 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 250 \text{ Pa}$														
						discharge sound						radiated sound								
	L _w in dB/Oct. (re 1pW)					L _p values		L _w in dB/Oct. (re 1pW)				L _p values								
	velocity	air volume				125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	125 Hz	250 Hz	500 Hz	1000 Hz	4000 Hz	
	m/s	l/s	CFM	m ³ /h	Pa	dB						dB						dB(A)	NC	NR
100	2	15	31	53	0	25	24	-	-	-	-	--	--	--	-	-	-	-	--	--
	4	29	62	106	1	32	31	20	-	-	-	--	--	--	25	20	-	-	20	-
	6	44	94	160	2	36	35	24	21	-	-	--	--	--	30	25	-	19	22	-
	8	59	125	213	4	39	38	27	24	-	-	--	--	--	35	29	20	23	25	-
	10	74	156	266	6	42	41	30	27	-	-	--	--	--	38	33	23	26	27	-
125	2	23	49	84	1	30	32	19	-	-	-	--	--	--	-	-	-	-	-	--
	4	47	99	168	2	37	39	26	17	-	-	--	--	--	25	20	18	-	-	--
	6	70	149	253	5	42	43	30	22	-	-	--	--	--	31	26	24	-	-	--
	8	94	198	337	8	45	46	34	25	-	-	--	--	--	35	30	28	19	17	-
	10	117	248	421	13	47	49	36	27	19	-	21	--	--	39	34	32	22	19	-
160	2	39	82	139	0	33	32	24	-	-	-	--	--	--	27	24	-	-	-	--
	4	78	164	279	2	40	38	31	20	-	-	--	--	--	35	33	22	-	-	--
	6	116	246	418	3	44	43	35	24	-	-	--	--	--	41	39	27	21	19	-
	8	155	328	558	6	47	46	38	27	-	-	--	--	--	45	43	32	24	21	--
	10	194	410	697	10	50	48	41	30	18	-	22	--	--	49	47	35	28	23	17
200	2	61	129	219	0	34	32	24	-	-	-	--	--	--	27	24	-	-	-	--
	4	122	258	439	2	41	39	31	23	18	-	--	--	--	36	32	18	-	17	--
	6	183	387	658	4	45	43	35	28	22	20	--	--	--	42	38	24	20	17	--
	8	244	516	878	8	48	46	38	31	25	23	--	--	--	46	42	28	24	22	18
	10	305	645	1097	12	51	49	41	33	28	25	--	--	--	50	46	32	27	24	20
250	2	96	203	345	1	36	33	26	23	21	-	--	--	--	28	21	-	-	-	--
	4	192	406	690	5	43	40	33	30	28	23	--	--	--	37	29	19	-	-	--
	6	288	609	1035	10	47	44	37	34	32	27	--	--	--	43	35	24	-	18	--
	8	383	812	1380	18	50	48	40	37	35	30	22	--	--	47	39	28	20	20	21
	10	479	1015	1725	28	52	50	43	40	38	33	25	--	--	51	43	32	23	22	18
315	2	153	324	550	1	38	37	31	28	24	21	--	--	--	30	24	-	-	-	--
	4	306	648	1101	4	45	44	38	35	31	28	--	--	--	39	32	23	-	18	--
	6	459	971	1651	8	49	48	42	39	35	32	22	--	--	44	38	28	20	21	--
	8	612	1295	2202	15	53	51	45	42	38	35	25	--	21	49	42	33	23	19	23
	10	764	1619	2752	23	55	54	48	45	41	38	28	21	24	52	46	36	26	25	20
355	2	195	412	701	1	41	40	37	33	28	21	--	--	--	31	24	-	-	-	--
	4	389	824	1401	5	48	47	43	40	35	28	21	--	--	40	32	22	-	-	--
	6	584	1236	2102	12	52	51	48	44	39	32	25	--	21	46	38	28	19	19	--
	8	779	1649	2803	22	55	55	51	47	42	35	28	22	24	50	42	32	23	21	24
	10	973	2061	3503	34	57	57	53	50	45	38	31	25	27	54	46	36	26	24	21
400	2	248	524	891	1	42	42	38	34	29	-	--	--	--	33	22	-	-	-	--
	4	495	1049	1783	4	49	48	45	41	36	23	22	--	--	42	31	18	-	-	--
	6	743	1573	2674	8	53	53	49	46	40	27	26	--	22	47	36	24	-	-	20
	8	990	2097	3565	15	56	56	52	49	43	30	30	23	26	52	41	28	19	17	25
	10	1238	2621	4456	23	59	58	55	51	46	33	32	26	28	55	44	32	22	19	-

1. Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.

2. L_w in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by “-”.

3. The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.

4. The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.

5. L_p values are including a room absorption of 10 dB/Oct.

6. dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by “--”.

7. Δ_ps is static pressure drop across VAV air volume control terminal with damper fully open.

8. For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	8	11	20	27	28	22	dB
125	7	10	19	26	27	21	dB
160	6	9	18	24	25	19	dB
200	5	10	16	22	23	20	dB
250	6	13	19	26	22	15	dB
315	6	12	19	25	21	17	dB
355	6	12	19	25	21	17	dB
400	5	11	15	19	19	14	dB

Rectangular CAV and VAV air volume control terminals Type NSOFOOB with integral sound attenuator



Sound data $\Delta p = 125 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 125 \text{ Pa}$														
						discharge sound						radiated sound								
	velocity		air volume			L _w in dB/Oct. (re 1pW)						L _p values			L _w in dB/Oct. (re 1pW)					
	m/s	l/s	CFM	m ³ /h	Pa	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	125 Hz	250 Hz	500 Hz	1000 Hz	4000 Hz	dB(A)
100	2	15	31	53	0	-	-	-	-	-	-	--	--	--	-	19	-	-	-	--
	4	29	62	106	1	23	21	-	-	-	-	--	--	--	22	23	-	-	18	-
	6	44	94	160	2	27	26	-	-	-	-	--	--	--	26	26	17	18	20	-
	8	59	125	213	4	29	30	-	-	-	-	--	--	--	28	28	19	20	21	-
	10	74	156	266	6	31	33	18	-	-	-	--	--	--	30	29	21	22	22	-
125	2	23	49	84	1	23	18	-	-	-	-	--	--	--	24	18	-	-	-	--
	4	47	99	168	2	30	28	-	-	-	-	--	--	--	29	23	21	-	-	--
	6	70	149	253	5	34	33	19	-	-	-	--	--	--	31	25	24	-	-	--
	8	94	198	337	8	36	37	23	-	-	-	--	--	--	33	27	26	18	17	-
	10	117	248	421	13	38	40	26	-	-	-	--	--	--	34	28	27	20	18	-
160	2	39	82	139	0	29	24	-	-	-	-	--	--	--	30	20	-	-	-	--
	4	78	164	279	2	33	31	-	-	-	-	--	--	--	37	30	19	-	-	--
	6	116	246	418	3	36	34	23	-	-	-	--	--	--	41	35	25	-	-	--
	8	155	328	558	6	37	37	28	-	-	-	--	--	--	44	40	30	21	-	--
	10	194	410	697	10	38	39	31	-	-	-	--	--	--	46	43	34	26	21	22
200	2	61	129	219	0	30	23	-	-	-	-	--	--	--	31	20	-	-	-	--
	4	122	258	439	2	35	30	-	-	-	-	--	--	--	38	30	-	-	-	--
	6	183	387	658	4	37	34	23	-	-	-	--	--	--	43	36	20	-	-	--
	8	244	516	878	8	38	36	27	-	-	-	--	--	--	46	40	25	20	-	20
	10	305	645	1097	12	39	38	31	21	-	-	--	--	--	48	44	28	25	21	-
250	2	96	203	345	1	25	-	-	-	-	-	--	--	--	26	18	-	-	-	--
	4	192	406	690	5	33	26	-	-	-	-	--	--	--	34	26	-	-	-	--
	6	288	609	1035	10	37	32	19	-	-	-	--	--	--	38	31	20	-	-	--
	8	383	812	1380	18	40	36	26	19	-	-	--	--	--	41	34	25	-	17	--
	10	479	1015	1725	28	42	40	31	25	21	18	--	--	--	44	37	28	20	20	--
315	2	153	324	550	1	-	-	-	-	-	-	--	--	--	22	19	-	-	-	--
	4	306	648	1101	4	26	24	-	-	-	-	--	--	--	34	29	17	-	-	--
	6	459	971	1651	8	36	33	22	-	-	-	--	--	--	42	34	25	-	-	--
	8	612	1295	2202	15	42	39	29	24	21	18	--	--	--	47	38	30	19	20	-
	10	764	1619	2752	23	48	44	35	31	26	21	--	--	--	51	42	34	24	23	-
355	2	195	412	701	1	-	-	-	-	-	-	--	--	--	23	19	-	-	-	--
	4	389	824	1401	5	27	27	-	-	-	-	--	--	--	36	29	-	-	-	--
	6	584	1236	2102	12	37	36	28	17	-	-	--	--	--	43	35	24	-	-	--
	8	779	1649	2803	22	44	42	36	27	22	-	--	--	--	48	39	29	19	19	-
	10	973	2061	3503	34	49	47	42	33	28	20	21	--	--	52	42	34	23	22	-
400	2	248	524	891	1	-	-	-	-	-	-	--	--	--	23	19	-	-	-	--
	4	495	1049	1783	4	27	27	18	-	-	-	--	--	--	36	28	-	-	-	--
	6	743	1573	2674	8	37	36	29	21	17	-	--	--	--	43	34	20	-	-	--
	8	990	2097	3565	15	44	42	37	30	25	-	--	--	--	49	38	26	-	-	22
	10	1238	2621	4456	23	49	47	43	37	30	18	22	--	--	53	42	30	20	18	-

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- Lw in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by “-”.
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

- dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by “-”.
- Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.
- For non standard applications and/or selections, please contact our technical staff.


Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1k	2k	4k	Hz
100	14	18	28	37	38	34	dB
125	13	17	27	36	38	33	dB
160	12	16	26	34	37	31	dB
200	11	17	24	32	35	32	dB
250	12	20	27	36	34	27	dB
315	12	19	27	35	33	29	dB
355	12	19	27	35	33	29	dB
400	11	18	23	29	31	26	dB

Rectangular CAV and VAV air volume control terminals Type NSOFOOB with integral sound attenuator



Sound data $\Delta p = 250 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 250 \text{ Pa}$																		
						discharge sound						radiated sound												
	Lw in dB/Oct. (re 1pW)					Lp values				Lw in dB/Oct. (re 1pW)				Lp values		dB				dB				
	velocity	air volume				125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	
	m/s	I/s	CFM	m^3/h	Pa	dB						dB						dB				dB(A)	NC	NR
100	2	15	31	53	0	19	17	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	4	29	62	106	1	26	24	-	-	-	-	-	-	-	-	25	20	-	-	20	-	-	-	
	6	44	94	160	2	30	28	-	-	-	-	-	-	-	-	30	25	-	19	22	-	-	-	
	8	59	125	213	4	33	31	19	-	-	-	-	-	-	-	35	29	20	23	25	-	-	-	
	10	74	156	266	6	36	34	22	-	-	-	-	-	-	-	38	33	23	26	27	-	-	-	
125	2	23	49	84	1	24	25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	4	47	99	168	2	31	32	18	-	-	-	-	-	-	-	25	20	18	-	-	-	-	-	
	6	70	149	253	5	36	36	22	-	-	-	-	-	-	-	31	26	24	-	-	-	-	-	
	8	94	198	337	8	39	39	26	-	-	-	-	-	-	-	35	30	28	19	17	-	-	-	
	10	117	248	421	13	41	42	28	17	-	-	-	-	-	-	39	34	32	22	19	-	-	-	
160	2	39	82	139	0	27	25	-	-	-	-	-	-	-	-	27	24	-	-	-	-	-	-	
	4	78	164	279	2	34	31	23	-	-	-	-	-	-	-	35	33	22	-	-	-	-	-	
	6	116	246	418	3	38	36	27	-	-	-	-	-	-	-	41	39	27	21	19	-	-	-	
	8	155	328	558	6	41	39	30	-	-	-	-	-	-	-	45	43	32	24	21	-	21	-	
	10	194	410	697	10	44	41	33	20	-	-	-	-	-	-	49	47	35	28	23	17	25	-	
200	2	61	129	219	0	28	25	-	-	-	-	-	-	-	-	27	24	-	-	-	-	-	-	
	4	122	258	439	2	35	32	23	-	-	-	-	-	-	-	36	32	18	-	17	-	-	-	
	6	183	387	658	4	39	36	27	18	-	-	-	-	-	-	42	38	24	20	20	17	-	-	
	8	244	516	878	8	42	39	30	21	-	-	-	-	-	-	46	42	28	24	22	18	21	-	
	10	305	645	1097	12	45	42	33	23	-	-	-	-	-	-	50	46	32	27	24	20	25	-	
250	2	96	203	345	1	30	26	18	-	-	-	-	-	-	-	28	21	-	-	-	-	-	-	
	4	192	406	690	5	37	33	25	20	-	-	-	-	-	-	37	29	19	-	-	-	-	-	
	6	288	609	1035	10	41	37	29	24	20	-	-	-	-	-	43	35	24	-	18	-	-	-	
	8	383	812	1380	18	44	41	32	27	23	18	--	--	--	--	47	39	28	20	20	-	21	-	
	10	479	1015	1725	28	46	43	35	30	26	21	--	--	--	--	51	43	32	23	22	18	24	-	
315	2	153	324	550	1	32	30	23	18	-	-	-	-	-	-	30	24	-	-	-	-	-	-	
	4	306	648	1101	4	39	37	30	25	19	-	-	-	-	-	39	32	23	-	18	-	-	-	
	6	459	971	1651	8	43	41	34	29	23	20	--	--	--	--	44	38	28	20	21	18	--	-	
	8	612	1295	2202	15	47	44	37	32	26	23	--	--	--	--	49	42	33	23	23	19	23	--	
	10	764	1619	2752	23	49	47	40	35	29	26	21	--	--	--	52	46	36	26	25	20	27	-	
355	2	195	412	701	1	35	33	29	23	-	-	-	-	-	-	31	24	-	-	-	-	-	-	
	4	389	824	1401	5	42	40	35	30	23	-	--	--	--	--	40	32	22	-	-	-	-	-	
	6	584	1236	2102	12	46	44	40	34	27	20	--	--	--	--	46	38	28	19	19	-	-	-	
	8	779	1649	2803	22	49	48	43	37	30	23	22	--	--	--	50	42	32	23	21	-	24	-	
	10	973	2061	3503	34	51	50	45	40	33	26	24	--	--	--	54	46	36	26	24	17	27	21	
400	2	248	524	891	1	36	35	30	24	-	-	-	-	-	-	33	22	-	-	-	-	-	-	
	4	495	1049	1783	4	43	41	37	31	24	-	--	--	--	--	42	31	18	-	-	-	-	-	
	6	743	1573	2674	8	47	46	41	36	28	-	--	--	--	--	47	36	24	-	-	20	-	-	
	8	990	2097	3565	15	50	49	44	39	31	18	23	--	--	--	52	41	28	19	17	-	25	-	
	10	1238	2621	4456	23	53	51	47	41	34	21	26	--	--	--	55	44	32	22	19	-	28	23	

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- Lw in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by “-”.
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.
- dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by “--”.
- Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.
- For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	14	18	28	37	38	34	dB
125	13	17	27	36	38	33	dB
160	12	16	26	34	37	31	dB
200	11	17	24	32	35	32	dB
250	12	20	27	36	34	27	dB
315	12	19	27	35	33	29	dB
355	12	19	27	35	33	29	dB
400	11	18	23	29	31	26	dB

Rectangular CAV and VAV air volume control terminals with integral sound attenuator

Type NSOK . OB
NSOR . OB



Sound data $\Delta p = 125 \text{ Pa}$

Model	data referring to inlet spigot					min. Δp_s	$\Delta p = 125 \text{ Pa}$																		
							discharge sound						radiated sound												
	velocity		air volume				L _w in dB/Oct. (re 1pW)						L _p values			L _w in dB/Oct. (re 1pW)						L _p values			
	m/s	l/s	CFM	m ³ /h	Pa		dB						dB(A)	NC	NR	dB						dB(A)	NC	NR	
100	2	15	31	53	0	min. Δp_s	24	19	-	-	-	-	-	-	-	19	-	-	-	-	-	-	-	-	
	4	29	62	106	2		31	29	-	-	-	-	-	-	-	22	23	-	-	18	-	-	-	-	
	6	44	94	160	4		35	35	22	19	-	-	-	-	-	26	26	17	18	20	-	-	-	-	
	8	59	125	213	7		38	39	26	22	-	-	-	-	-	28	28	19	20	21	-	-	-	-	
	10	74	156	266	10		40	42	29	25	-	-	-	-	-	30	29	21	22	22	-	-	-	-	
125	2	23	49	84	1	min. Δp_s	30	26	-	-	-	-	-	-	-	24	18	-	-	-	-	-	-	-	
	4	47	99	168	5		37	36	24	-	-	-	-	-	-	29	23	21	-	-	-	-	-	-	
	6	70	149	253	11		42	42	29	21	-	-	-	-	-	31	25	24	-	-	-	-	-	-	
	8	94	198	337	19		44	46	33	24	17	-	-	-	-	33	27	26	18	17	-	-	-	-	
	10	117	248	421	29		46	49	36	27	18	-	22	-	-	34	28	27	20	18	-	-	-	-	
160	2	39	82	139	1	min. Δp_s	36	32	-	-	-	-	-	-	-	30	20	-	-	-	-	-	-	-	
	4	78	164	279	5		41	39	26	-	-	-	-	-	-	37	30	19	-	-	-	-	-	-	
	6	116	246	418	12		44	43	33	20	-	-	-	-	-	41	35	25	-	-	-	-	-	-	
	8	155	328	558	22		46	46	38	25	17	-	-	-	-	44	40	30	21	-	-	-	-	-	
	10	194	410	697	34		47	48	42	29	19	-	21	-	-	46	43	34	26	21	-	22	-	-	
200	2	61	129	219	2	min. Δp_s	37	31	-	-	-	-	-	-	-	31	20	-	-	-	-	-	-	-	
	4	122	258	439	6		42	39	26	-	20	22	-	-	-	38	30	-	-	-	-	-	-	-	
	6	183	387	658	14		45	43	33	24	23	25	-	-	-	43	36	20	-	-	-	-	-	-	
	8	244	516	878	25		47	45	38	29	26	27	-	-	-	46	40	25	20	-	-	20	-	-	
	10	305	645	1097	38		48	48	41	33	27	28	21	-	-	48	44	28	25	21	-	23	-	-	
250	2	96	203	345	2	min. Δp_s	33	22	-	-	-	-	-	-	-	26	18	-	-	-	-	-	-	-	
	4	192	406	690	9		41	34	19	-	-	-	-	-	-	34	26	-	-	-	-	-	-	-	
	6	288	609	1035	21		45	41	29	22	22	22	-	-	-	38	31	20	-	-	-	-	-	-	
	8	383	812	1380	37		48	46	36	31	30	28	20	-	-	41	34	25	-	17	-	-	-	-	
	10	479	1015	1725	58		50	49	41	38	36	33	23	-	-	44	37	28	20	-	-	-	-	-	
315	2	153	324	550	2	min. Δp_s	-	-	-	-	-	-	-	-	-	22	19	-	-	-	-	-	-	-	
	4	306	648	1101	8		33	33	20	-	-	19	-	-	-	34	29	17	-	-	-	-	-	-	
	6	459	971	1651	18		44	42	32	27	28	27	-	-	-	42	34	25	-	-	-	-	-	-	
	8	612	1295	2202	32		51	49	40	36	35	32	23	-	-	47	38	30	19	20	-	21	-	-	
	10	764	1619	2752	50		56	54	46	44	41	36	28	21	23	51	42	34	24	23	-	24	-	-	
355	2	195	412	701	3	min. Δp_s	-	20	-	-	-	-	-	-	-	23	19	-	-	-	-	-	-	-	
	4	389	824	1401	12		35	36	26	-	18	19	-	-	-	36	29	-	-	-	-	-	-	-	
	6	584	1236	2102	28		45	45	38	29	29	26	-	-	-	43	35	24	-	-	-	-	-	-	
	8	779	1649	2803	50		52	52	46	39	37	31	25	-	21	48	39	29	19	19	-	22	-	-	
	10	973	2061	3503	78		58	57	52	46	42	35	31	24	27	52	42	34	23	22	-	25	-	21	
400	2	248	524	891	2	min. Δp_s	-	20	-	-	-	-	-	-	-	23	19	-	-	-	-	-	-	-	
	4	495	1049	1783	9		35	36	27	19	21	-	-	-	-	36	28	-	-	-	-	-	-	-	
	6	743	1573	2674	20		45	45	39	33	31	24	-	-	-	43	34	20	-	-	-	-	-	-	
	8	990	2097	3565	36		53	52	47	42	39	29	26	-	21	49	38	26	-	-	22	-	-	-	
	10	1238	2621	4456	57		58	57	53	50	45	33	31	24	27	53	42	30	20	18	-	26	-	22	

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- Lw in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by "-".
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

6. dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by "-".

7. Δps is static pressure drop across VAV air volume control terminal with damper fully open.

8. For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	9	12	22	30	31	25	dB
125	8	12	21	29	30	24	dB
160	7	10	20	27	28	22	dB
200	6	11	18	25	26	23	dB
250	7	14	21	29	25	18	dB
315	7	13	21	28	24	20	dB
355	7	13	21	28	24	20	dB
400	6	12	17	22	22	17	dB

Rectangular CAV and VAV air volume control terminals

Type NSOK . OB
NSOR . OB



Sound data $\Delta p = 250 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 250 \text{ Pa}$																	
						discharge sound								radiated sound									
	velocity		air volume			L_w in dB/Oct. (re 1pW)						Lp values			L_w in dB/Oct. (re 1pW)						Lp values		
	m/s	l/s	CFM	m^3/h	Pa	dB						dBA(A)	NC	NR	dB						dBA(A)	NC	NR
100	2	15	31	53	0	26	25	-	-	-	-	--	--	--	-	-	-	-	-	-	--	--	--
	4	29	62	106	2	33	33	21	18	-	-	--	--	--	25	20	-	-	20	-	--	--	--
	6	44	94	160	4	38	37	26	23	-	-	--	--	--	30	25	-	19	22	-	--	--	--
	8	59	125	213	7	41	40	29	26	-	-	--	--	--	35	29	20	23	25	-	--	--	--
	10	74	156	266	10	44	43	32	29	-	-	--	--	--	38	33	23	26	27	-	--	--	--
125	2	23	49	84	1	32	33	21	-	-	-	--	--	--	-	-	-	-	-	-	--	--	--
	4	47	99	168	5	39	40	28	19	-	-	--	--	--	25	20	18	-	-	-	--	--	--
	6	70	149	253	11	43	45	32	23	-	-	--	--	--	31	26	24	-	-	-	--	--	--
	8	94	198	337	19	47	48	36	27	18	-	21	--	--	35	30	28	19	17	-	--	--	--
	10	117	248	421	29	50	51	39	30	21	-	24	--	20	39	34	32	22	19	-	--	--	--
160	2	39	82	139	1	34	33	25	-	-	-	--	--	--	27	24	-	-	-	-	--	--	--
	4	78	164	279	5	42	40	33	21	-	-	--	--	--	35	33	22	-	-	-	--	--	--
	6	116	246	418	12	46	44	37	26	-	-	--	--	--	41	39	27	21	19	-	--	--	--
	8	155	328	558	22	49	48	40	29	17	-	22	--	--	45	43	32	24	21	-	21	--	--
	10	194	410	697	34	52	51	43	32	20	17	25	--	20	49	47	35	28	23	17	25	--	21
200	2	61	129	219	2	35	33	25	18	-	-	--	--	--	27	24	-	-	-	-	--	--	--
	4	122	258	439	6	42	40	32	25	19	-	--	--	--	36	32	18	-	17	-	--	--	--
	6	183	387	658	14	47	45	37	29	24	21	--	--	--	42	38	24	20	20	17	--	--	--
	8	244	516	878	25	50	48	40	33	27	25	22	--	--	46	42	28	24	22	18	21	--	--
	10	305	645	1097	38	53	51	43	36	30	28	25	--	21	50	46	32	27	24	20	25	--	20
250	2	96	203	345	2	37	35	27	24	22	17	--	--	--	28	21	-	-	-	-	--	--	--
	4	192	406	690	9	44	42	34	32	29	25	--	--	--	37	29	19	-	-	-	--	--	--
	6	288	609	1035	21	48	46	39	36	34	29	21	--	--	43	35	24	-	18	-	--	--	--
	8	383	812	1380	37	52	50	42	39	37	32	24	--	--	47	39	28	20	20	-	21	--	--
	10	479	1015	1725	58	55	53	45	42	40	35	27	--	22	51	43	32	23	22	18	24	--	--
315	2	153	324	550	2	40	38	32	29	25	22	--	--	--	30	24	-	-	-	-	--	--	--
	4	306	648	1101	8	47	45	40	36	33	29	--	--	--	39	32	23	-	18	-	--	--	--
	6	459	971	1651	18	51	50	44	41	37	34	24	--	--	44	38	28	20	21	18	--	--	--
	8	612	1295	2202	32	55	53	48	44	40	37	27	20	23	49	42	33	23	23	19	23	--	--
	10	764	1619	2752	50	58	56	50	47	43	40	30	24	26	52	46	36	26	25	20	27	--	21
355	2	195	412	701	3	42	42	38	34	29	22	--	--	--	31	24	-	-	-	-	--	--	--
	4	389	824	1401	12	49	49	45	41	36	29	22	--	--	40	32	22	-	-	-	--	--	--
	6	584	1236	2102	28	53	53	49	46	41	34	27	--	23	46	38	28	19	19	-	--	--	--
	8	779	1649	2803	50	57	57	53	49	44	37	30	24	26	50	42	32	23	21	-	24	--	--
	10	973	2061	3503	78	60	59	56	52	47	40	33	27	30	54	46	36	26	24	17	27	21	23
400	2	248	524	891	2	43	43	39	36	30	17	--	--	--	33	22	-	-	-	-	--	--	--
	4	495	1049	1783	9	51	50	46	43	37	25	24	--	--	42	31	18	-	-	-	--	--	--
	6	743	1573	2674	20	55	54	51	47	42	29	28	21	24	47	36	24	-	-	-	20	--	--
	8	990	2097	3565	36	58	58	54	51	45	33	32	25	28	52	41	28	19	17	-	25	--	20
	10	1238	2621	4456	57	61	61	57	54	48	35	35	29	31	55	44	32	22	19	-	28	23	25

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- L_w in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by "-".
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

6. dBA, NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by "-".

7. Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.

8. For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation


Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	9	12	22	30	31	25	dB
125	8	12	21	29	30	24	dB
160	7	10	20	27	28	22	dB
200	6	11	18	25	26	23	dB
250	7	14	21	29	25	18	dB
315	7	13	21	28	24	20	dB
355	7	13	21	28	24	20	dB
400	6	12	17	22	22	17	dB

Rectangular CAV and VAV air volume control terminals with integral sound attenuator

Type NSOM . OB
NSOT . OB



Sound data $\Delta p = 125 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 125 \text{ Pa}$																		
						discharge sound										radiated sound								
	air volume					L_w in dB/Oct. (re 1pW)						Lp values			L_w in dB/Oct. (re 1pW)						Lp values			
	velocity	m/s	l/s	CFM	m^3/h	Pa	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR
							dB						dB						dB					
100	2	15	31	53	0	0	18	-	-	-	-	-	--	--	--	-	19	-	-	-	-	--	--	--
	4	29	62	106	2	2	25	22	-	-	-	-	--	--	--	22	23	-	-	18	-	--	--	--
	6	44	94	160	4	4	29	28	-	-	-	-	--	--	--	26	26	17	18	20	-	--	--	--
	8	59	125	213	7	7	32	32	18	-	-	-	--	--	--	28	28	19	20	21	-	--	--	--
	10	74	156	266	10	10	34	35	21	-	-	-	--	--	--	30	29	21	22	22	-	--	--	--
125	2	23	49	84	1	1	24	19	-	-	-	-	--	--	--	24	18	-	-	-	-	--	--	--
	4	47	99	168	5	5	31	29	-	-	-	-	--	--	--	29	23	21	-	-	-	--	--	--
	6	70	149	253	11	11	36	35	21	-	-	-	--	--	--	31	25	24	-	-	-	--	--	--
	8	94	198	337	19	19	38	39	25	-	-	-	--	--	--	33	27	26	18	17	-	--	--	--
	10	117	248	421	29	29	40	42	28	-	-	-	--	--	--	34	28	27	20	18	-	--	--	--
160	2	39	82	139	1	1	30	25	-	-	-	-	--	--	--	30	20	-	-	-	-	--	--	--
	4	78	164	279	5	5	35	32	18	-	-	-	--	--	--	37	30	19	-	-	-	--	--	--
	6	116	246	418	12	12	38	36	25	-	-	-	--	--	--	41	35	25	-	-	-	--	--	--
	8	155	328	558	22	22	40	39	30	-	-	-	--	--	--	44	40	30	21	-	-	--	--	--
	10	194	410	697	34	34	41	41	34	19	-	-	--	--	--	46	43	34	26	21	-	22	--	--
200	2	61	129	219	2	2	31	24	-	-	-	-	--	--	--	31	20	-	-	-	-	--	--	--
	4	122	258	439	6	6	36	32	18	-	-	-	--	--	--	38	30	-	-	-	-	--	--	--
	6	183	387	658	14	14	39	36	25	-	-	-	--	--	--	43	36	20	-	-	-	--	--	--
	8	244	516	878	25	25	41	38	30	19	-	-	--	--	--	46	40	25	20	-	-	20	--	--
	10	305	645	1097	38	38	42	41	33	23	-	-	--	--	--	48	44	28	25	21	-	23	--	--
250	2	96	203	345	2	2	27	-	-	-	-	-	--	--	--	26	18	-	-	-	-	--	--	--
	4	192	406	690	9	9	35	27	-	-	-	-	--	--	--	34	26	-	-	-	-	--	--	--
	6	288	609	1035	21	21	39	34	21	-	-	-	--	--	--	38	31	20	-	-	-	--	--	--
	8	383	812	1380	37	37	42	39	28	21	18	-	--	--	--	41	34	25	-	17	-	--	--	--
	10	479	1015	1725	58	58	44	42	33	28	24	21	--	--	--	44	37	28	20	20	-	--	--	--
315	2	153	324	550	2	2	-	-	-	-	-	-	--	--	--	22	19	-	-	-	-	--	--	--
	4	306	648	1101	8	8	27	26	-	-	-	-	--	--	--	34	29	17	-	-	-	--	--	--
	6	459	971	1651	18	18	38	35	24	-	-	-	--	--	--	42	34	25	-	-	-	--	--	--
	8	612	1295	2202	32	32	45	42	32	26	23	20	--	--	--	47	38	30	19	20	-	21	--	--
	10	764	1619	2752	50	50	47	38	34	29	24	22	--	--	--	51	42	34	24	23	-	24	--	--
355	2	195	412	701	3	3	-	-	-	-	-	-	--	--	--	23	19	-	-	-	-	--	--	--
	4	389	824	1401	12	12	29	29	18	-	-	-	--	--	--	36	29	-	-	-	-	--	--	--
	6	584	1236	2102	28	28	39	38	30	19	17	-	--	--	--	43	35	24	-	-	-	--	--	--
	8	779	1649	2803	50	50	46	45	38	29	25	19	--	--	--	48	39	29	19	19	-	22	--	--
	10	973	2061	3503	78	78	52	50	44	36	30	23	24	--	--	52	42	34	23	22	-	25	--	21
400	2	248	524	891	2	2	-	-	-	-	-	-	--	--	--	23	19	-	-	-	-	--	--	--
	4	495	1049	1783	9	9	29	29	19	-	-	-	--	--	--	36	28	-	-	-	-	--	--	--
	6	743	1573	2674	20	20	39	38	31	23	19	-	--	--	--	43	34	20	-	-	-	--	--	--
	8	990	2097	3565	36	36	47	45	39	32	27	17	--	--	--	49	38	26	-	-	-	22	--	--
	10	1238	2621	4456	57	57	52	50	45	40	33	21	24	--	--	53	42	30	20	18	-	26	--	22

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- L_w in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by "-".
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

6. dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by "-".

7. Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.

8. For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20


Table 2: Insertion Loss

Model	125	250	500	1k	2k	4k	Hz
100	15	19	30	38	38	37	dB
125	14	19	29	38	38	36	dB
160	13	17	28	37	38	34	dB
200	12	18	26	35	38	35	dB
250	13	21	29	38	37	30	dB
315	13	20	29	38	36	32	dB
355	13	20	29	38	36	32	dB
400	12	19	25	32	34	29	dB

Rectangular CAV and VAV air volume control terminals

with integral sound attenuator

Type NSOM . OB
NSOT . OB



Sound data $\Delta p = 250 \text{ Pa}$

Model	data referring to inlet spigot				min. Δp_s	$\Delta p = 250 \text{ Pa}$																		
						discharge sound						radiated sound												
	air volume					Lw in dB/Oct. (re 1pW)				Lp values		Lw in dB/Oct. (re 1pW)				Lp values		dB						
	velocity	m/s	l/s	CFM	m³/h	Pa	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	dB(A)	NC	NR
100	2	15	31	53	0	20	18	-	-	-	-	-	-	--	--	-	-	-	-	-	-	--	--	--
	4	29	62	106	2	27	26	-	-	-	-	-	-	--	--	25	20	-	-	20	-	--	--	--
	6	44	94	160	4	32	30	18	-	-	-	-	-	--	--	30	25	-	19	22	-	--	--	--
	8	59	125	213	7	35	33	21	-	-	-	-	-	--	--	35	29	20	23	25	-	--	--	--
	10	74	156	266	10	38	36	24	19	-	-	-	-	--	--	38	33	23	26	27	-	--	--	--
125	2	23	49	84	1	26	26	-	-	-	-	-	-	--	--	-	-	-	-	-	-	--	--	--
	4	47	99	168	5	33	33	20	-	-	-	-	-	--	--	25	20	18	-	-	-	--	--	--
	6	70	149	253	11	37	38	24	-	-	-	-	-	--	--	31	26	24	-	-	-	--	--	--
	8	94	198	337	19	41	41	28	-	-	-	-	-	--	--	35	30	28	19	17	-	--	--	--
	10	117	248	421	29	44	44	31	20	-	-	-	-	--	--	39	34	32	22	19	-	--	--	--
160	2	39	82	139	1	28	26	17	-	-	-	-	-	--	--	27	24	-	-	-	-	--	--	--
	4	78	164	279	5	36	33	25	-	-	-	-	-	--	--	35	33	22	-	-	-	--	--	--
	6	116	246	418	12	40	37	29	-	-	-	-	-	--	--	41	39	27	21	19	-	--	--	--
	8	155	328	558	22	43	41	32	19	-	-	-	-	--	--	45	43	32	24	21	-	21	--	--
	10	194	410	697	34	46	44	35	22	-	-	-	-	--	--	49	47	35	28	23	17	25	--	21
200	2	61	129	219	2	29	26	17	-	-	-	-	-	--	--	27	24	-	-	-	-	--	--	--
	4	122	258	439	6	36	33	24	-	-	-	-	-	--	--	36	32	18	-	17	-	--	--	--
	6	183	387	658	14	41	38	29	19	-	-	-	-	--	--	42	38	24	20	20	17	--	--	--
	8	244	516	878	25	44	41	32	23	-	-	-	-	--	--	46	42	28	24	22	18	21	--	--
	10	305	645	1097	38	47	44	35	26	18	-	-	-	--	--	50	46	32	27	24	20	25	--	20
250	2	96	203	345	2	31	28	19	-	-	-	-	-	--	--	28	21	-	-	-	-	--	--	--
	4	192	406	690	9	38	35	26	22	17	-	-	-	--	--	37	29	19	-	-	-	--	--	--
	6	288	609	1035	21	42	39	31	26	22	17	-	-	--	--	43	35	24	-	18	-	--	--	--
	8	383	812	1380	37	46	43	34	29	25	20	-	-	--	--	47	39	28	20	20	-	21	--	--
	10	479	1015	1725	58	49	46	37	32	28	23	20	-	--	--	51	43	32	23	22	18	24	--	--
315	2	153	324	550	2	34	31	24	19	-	-	-	-	--	--	30	24	-	-	-	-	--	--	--
	4	306	648	1101	8	41	38	32	26	21	17	-	-	--	--	39	32	23	-	18	-	--	--	--
	6	459	971	1651	18	45	43	36	31	25	22	-	-	--	--	44	38	28	20	21	18	--	--	--
	8	612	1295	2202	32	49	46	40	34	28	25	21	-	--	--	49	42	33	23	23	19	23	--	--
	10	764	1619	2752	50	52	49	42	37	31	28	24	-	--	--	52	46	36	26	25	20	27	--	21
355	2	195	412	701	3	36	35	30	24	-	-	-	-	--	--	31	24	-	-	-	-	--	--	--
	4	389	824	1401	12	43	42	37	31	24	17	-	-	--	--	40	32	22	-	-	-	--	--	--
	6	584	1236	2102	28	47	46	41	36	29	22	20	-	--	--	46	38	28	19	19	-	--	--	--
	8	779	1649	2803	50	51	50	45	39	32	25	24	-	--	--	50	42	32	23	21	-	24	--	--
	10	973	2061	3503	78	54	52	48	42	35	28	26	-	--	--	54	46	36	26	24	17	27	21	23
400	2	248	524	891	2	37	36	31	26	18	-	-	-	--	--	33	22	-	-	-	-	--	--	--
	4	495	1049	1783	9	45	43	38	33	25	-	-	-	--	--	42	31	18	-	-	-	--	--	--
	6	743	1573	2674	20	49	47	43	37	30	17	22	-	--	--	47	36	24	-	-	-	20	--	--
	8	990	2097	3565	36	52	51	46	41	33	21	25	-	--	--	52	41	28	19	17	-	25	--	20
	10	1238	2621	4456	57	55	54	49	44	36	23	28	21	--	--	55	44	32	22	19	-	28	23	25

- Sound data is determined in a reverberation room at an independent sound laboratory, according to ISO 3741 and ISO 5135 standards.
- Lw in dB/Oct. (re 1pW) are sound power levels for discharge sound and case radiated sound. Figures less than 17 dB are indicated by "-".
- The discharge sound pressure levels are determined with the assumptions as mentioned in table 1 for downstream ductwork including a diffuser with insulated plenum box.
- The radiated sound pressure levels are determined with the assumptions as mentioned in table 1 for ceiling plenum and suspended ceiling absorption.
- Lp values are including a room absorption of 10 dB/Oct.

- dB(A), NC and NR index figures are sound pressure levels. Figures less than 20 are indicated by "-".
- Δp_s is static pressure drop across VAV air volume control terminal with damper fully open.
- For non standard applications and/or selections, please contact our technical staff.

Table 1: Assumptions for additional attenuation

Hz	125	250	500	1K	2K	4K
Discharge (dB)	5	10	20	30	30	25
Radiated (dB)	2	5	10	15	15	20

Table 2: Insertion Loss

Model	125	250	500	1K	2K	4K	Hz
100	15	19	30	38	38	37	dB
125	14	19	29	38	38	36	dB
160	13	17	28	37	38	34	dB
200	12	18	26	35	38	35	dB
250	13	21	29	38	37	30	dB
315	13	20	29	38	36	32	dB
355	13	20	29	38	36	32	dB
400	12	19	25	32	34	29	dB

**HC Barcol-Air**

P.O. Box 283, 1440 AG Purmerend, the Netherlands
T +31 (0)299 689 300 | F +31 (0)299 436 932
info@barcol-air.nl | www.barcol-air.nl